



SCHEME OF CONNECTION

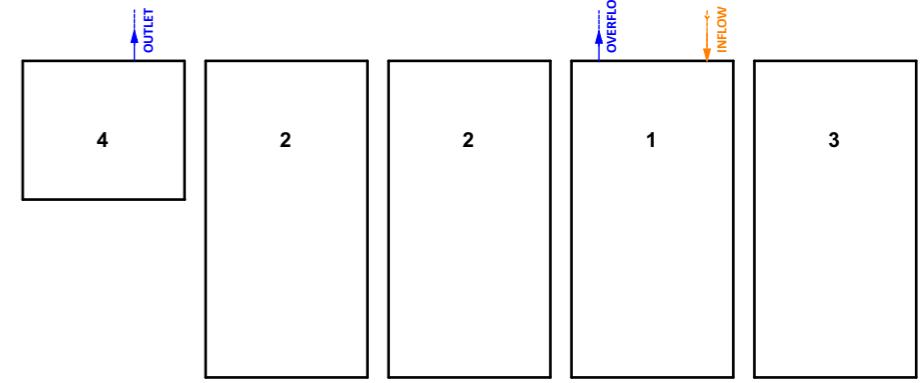


LEGEND:

- 1 INFLOW TANK
 - 2 REACTOR
 - 3 SLUDGE TANK
 - 4 SAND FILTER
 - 5 OPERATING HOUSE
- SURROUNDING GROUND
 - EXCAVATED SOIL WITHOUT STONES
 - COMPACTED GRAVEL-SAND 100% PGS
 - GRAVEL-SAND COEFF. OF FRICTION ≤ 0.3 BACKFILL IN LAYERS app. cca 0.3 m AND COMPACT TO 100% PGS
 - GRAVEL
 - CONCRETE SLAB C15/20 REINFORCED WITH KARI NET
 - CONCRETE C15/20

INSTALLATION ABOVE THE GROUND WATER LEVEL
SECTION A-A

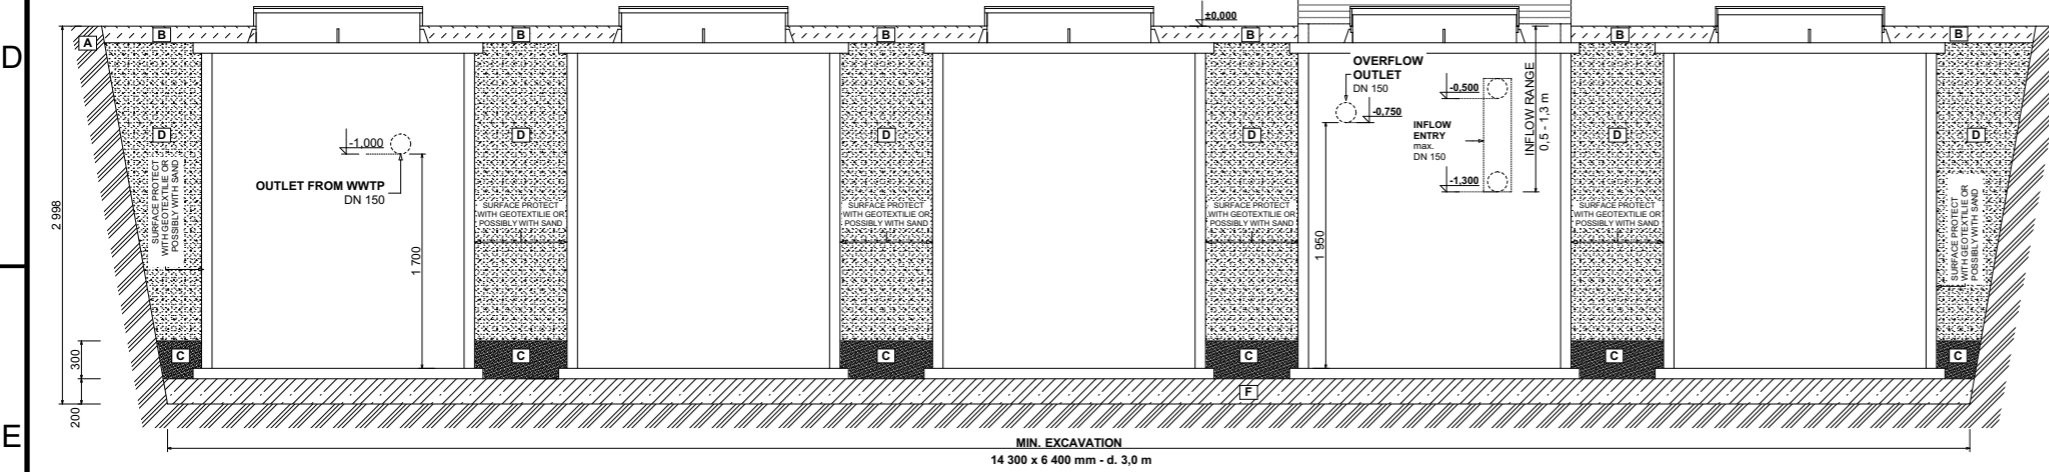

INSTALLATION BELOW THE GROUND WATER LEVEL
SECTION A-A

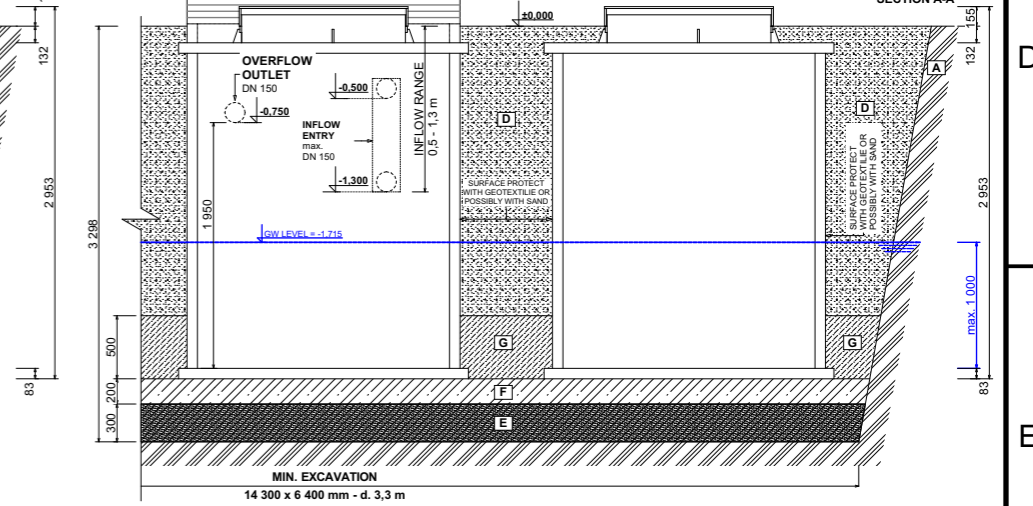

PROJECTION		DRAWN	KRČMÁŘOVÁ	WEIGHT	---- kg	SCALE	1:60
CHECKED	VILÍM	MATERIAL	PP 2x8 mm	Max. flow	52,5 m ³ /day	TECHNICAL SHEET	
APPROVED		BOD ₅	21,0 kg/day	DATE	12. 02. 2016		



NAME Biological wastewater treatment plant	NUMBER	IS
	REVISION	
	TYPE WWTP TOPAS S 350 PF	
		PAGE 1/1