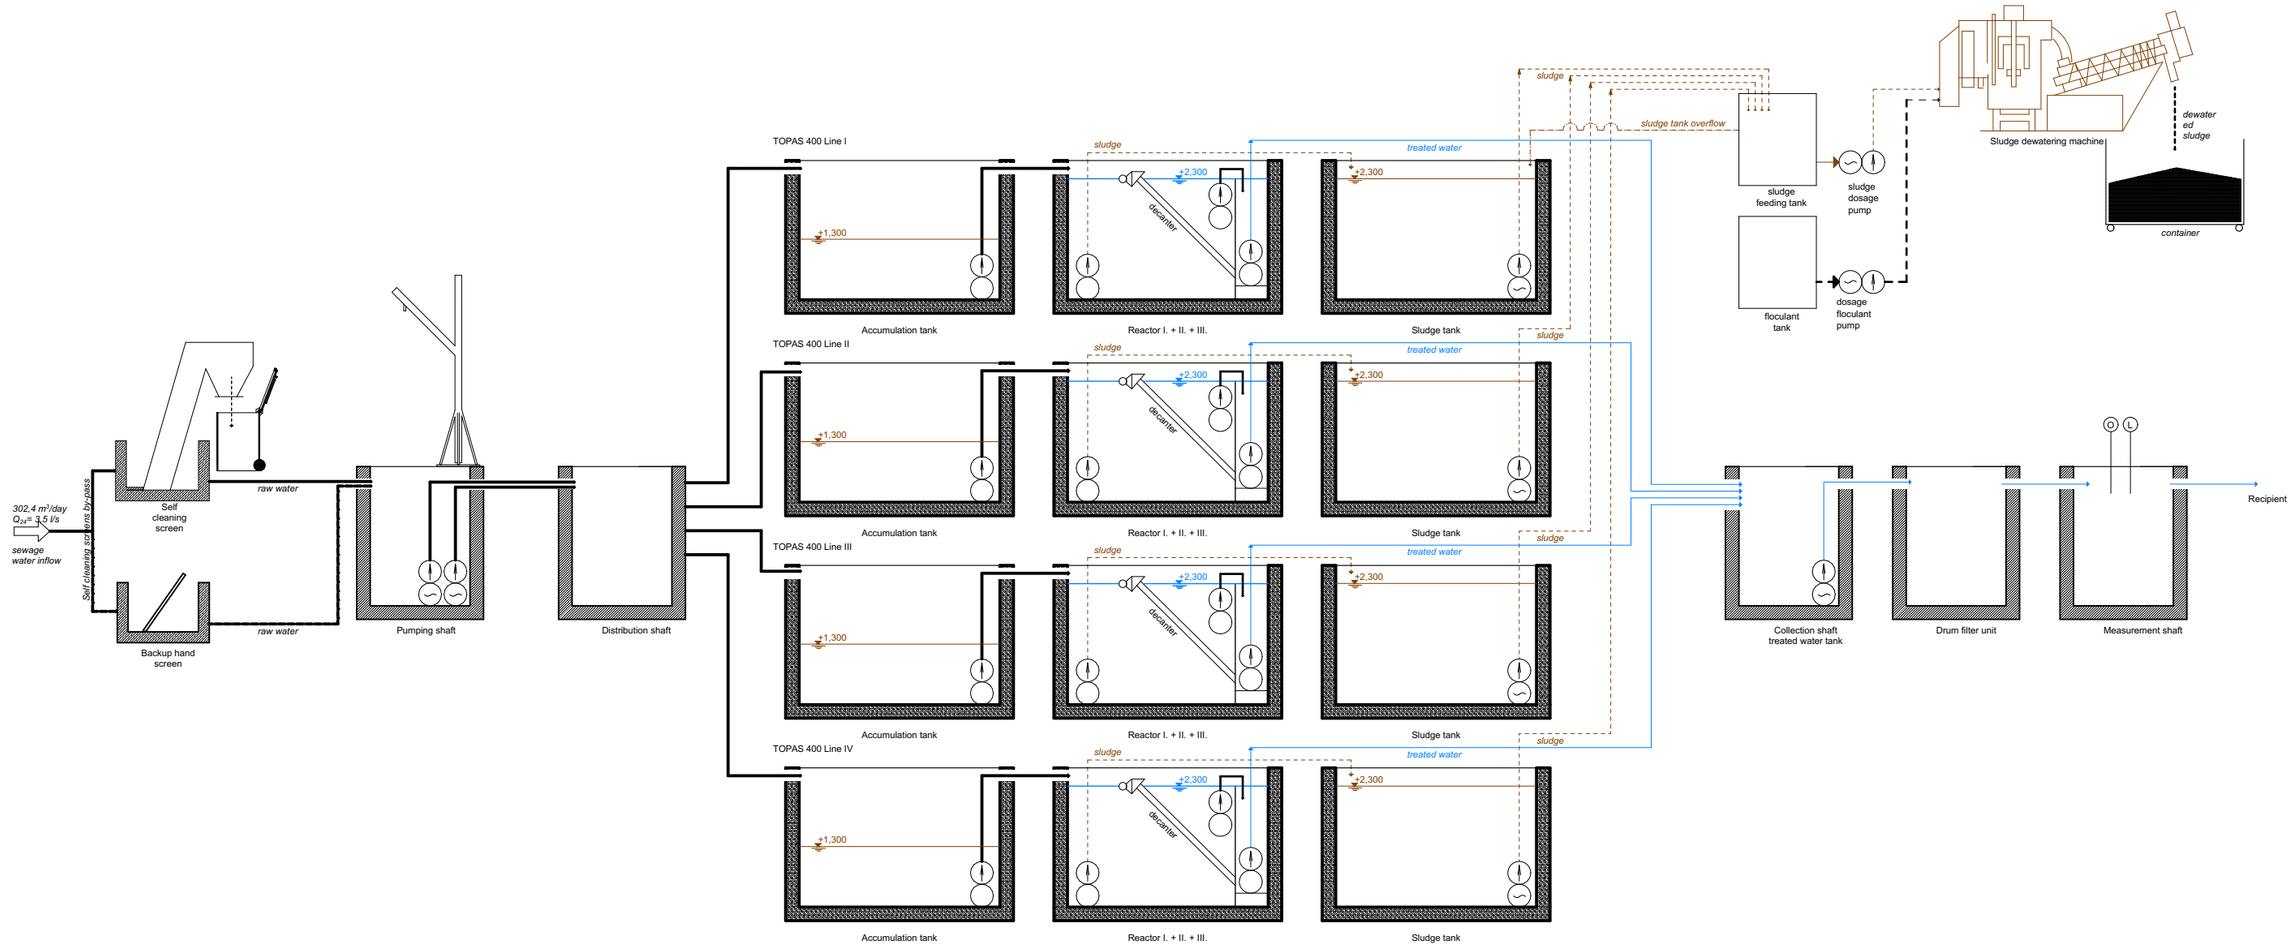
302,4 m³/day
Q24= 3,5 l/s
sewage water inflow
Self-cleaning screens by-pass
Self cleaning screen
Backup hand screen
raw water
raw water
Pumping shaft
Distribution shaft
TOPAS 400 Line I
TOPAS 400 Line II
TOPAS 400 Line III
TOPAS 400 Line IV
Accumulation tank
Reactor I. + II. + III.
Sludge tank
+1,300
+2,300
decanter
sludge
treated water
sludge tank overflow
sludge feeding tank
flocculant tank
sludge dosage pump
dosage flocculant pump
Sludge dewatering machine
dewatered sludge
container
Collection shaft treated water tank
Drum filter unit
Measurement shaft
Recipient